



ABN 43 064 478 842

231 Osborne Avenue Clayton South, VIC 3169
PO Box 1548, Clayton South, VIC 3169
t 03 9265 7400 f 03 9558 0875
freecall 1800 680 680
www.tmgtestequipment.com.au

Test & Measurement

- > sales
- > rentals
- > calibration
- > repair
- > disposal

Complimentary Reference Material

This PDF has been made available as a complimentary service for you to assist in evaluating this model for your testing requirements.

TMG offers a wide range of test equipment solutions, from renting short to long term, buying refurbished and purchasing new. Financing options, such as Financial Rental, and Leasing are also available on application.

TMG will assist if you are unsure whether this model will suit your requirements.

Call TMG if you need to organise repair and/or calibrate your unit.

If you click on the "Click-to-Call" logo below, you can call us for FREE!

TMG Corporate Website

TMG Products Website



Click-to-Call
TMG Now



Product Lifecycle Management System

Disclaimer:

All trademarks appearing within this PDF are trademarks of their respective owners.



CTER-91

Current Transformer Excitation, Ratio and Polarity Test Set



- Can test bushing CTs mounted inside transformer or switchgear
- Saturation, ratio and polarity tests performed without changing test lead connections
- Overload and short-circuit protection

DESCRIPTION

The CTER-91 test set is a lightweight, portable unit for performing excitation, ratio and polarity tests on current transformers using the voltage-comparison method.

Utilizing the latest technology, Model CTER-91 provides a variable voltage output and precision instrumentation for testing single and multiratio CTs. All three tests – excitation, ratio and polarity – can be performed without changing any leads.

Current transformers can be tested in their equipment configuration, such as being mounted in transformers, oil circuit breakers or switchgear.

It is necessary for the equipment to be totally isolated from the electrical system prior to testing.

APPLICATIONS

Saturation Test

Model CTER-91 provides a variable voltage output and digital instrumentation for measuring the excitation voltage and excitation current that results as the voltage applied to the CT under test is increased.

As the CT under test begins to saturate, a large increase in current will be detected for a small increase in voltage.

Ratio Test

The ratio test is performed by comparing a voltage applied to the secondary winding to the resulting voltage produced on the primary winding.

For example, if 1 volt per turn is applied to the secondary winding, the voltage present on the primary winding would be 1 volt.

More specifically, if 120 volts were applied to the secondary of a 600/5 current transformer (120:1 ratio), 1 volt would be present on the primary winding.

Polarity Test

Polarity of the current transformer under test is determined by special circuitry that divides the voltage applied to the secondary winding by either 10 or 100, depending on switch position, then adds the result to the primary voltage.

An increase in magnitude indicates correct polarity, and a decrease shows incorrect polarity.

FEATURES AND BENEFITS

- Voltmeter can be used to measure external voltages up to 600 volts ac.
- A RUN/HOLD switch freezes readings on instruments when switched to the HOLD position.
- A low range of 40 volts is provided for CTs that saturate at low voltages.
- The unit provides a high range of 1000 volts.
- A zero-start interlock is incorporated. This minimizes the possibility of energizing the CT under test with a sudden high voltage.

SPECIFICATIONS

Input

120 V, 1 ϕ , 50/60 Hz **OR** 240 V, 1 ϕ , 50/60 Hz

Output

Continuously variable in four ranges:

- 0 to 40 V at 1.5 A max
- 0 to 150 V at 1.5 A max
- 0 to 600 V at 1.5 A max
- 0 to 1000 V at 1.0 A max (5 min on, 15 min off)

Instrumentation

Voltmeters

Two 4½-digit, autoranging

Solid-state Instruments

Ranges: 0.0000 to 1.9999/19.999/199.99/600.0/1000 V

Accuracy: ±0.25% of reading, ±1 digit for 1 to 1000 V; ±1% of reading ±1 digit for 0.2 to 1 V

Ammeter

One 4½-digit

Solid-state Instrument

Range: 0.0000 to 1.9999 A

Accuracy: ±0.85% of reading, ±1 digit

Enclosure


The unit is housed in a high-strength, molded suitcase-type enclosure with carrying handle and removable cover. Storage space is provided for test leads.

Dimensions


9.9 H x 14.1 W x 11.9 D in.
(251 H x 357 W x 287 D mm)

Weight

37 lb (16.8 kg)

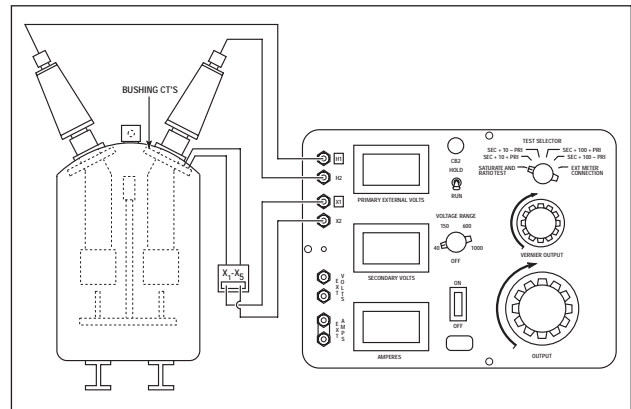

Connections for performing saturation, ratio and polarity tests

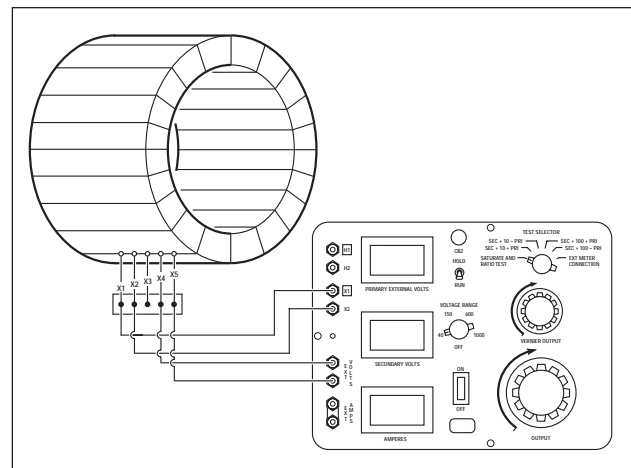

Connections for verifying ratios of a multiratio CT

ORDERING INFORMATION

Item (Qty)	Cat. No.
Model CTER-91	
115 volt input, 50/60 Hz	CTER-91-115
230 volt input, 50/60 Hz	CTER-91-230
Included Accessories	
Test leads	
18 AWG, 5 ft (1.5 m) [1 pr]	1282
18 AWG, 12 ft (3.7 m) [1 pr]	2997
Line cord [1]	6828
Instruction manual [1]	14355

UK
Archcliffe Road Dover
CT17 9EN England
T +44 (0) 1304 502101
F +44 (0) 1304 207342

UNITED STATES
4271 Bronze Way
Dallas TX75237-1088 USA
T 800 723 2861 (USA only)
T +1 214 330 3203
F +1 214 337 3038

OTHER TECHNICAL SALES OFFICES
Valley Forge USA, Toronto CANADA,
Mumbai INDIA, Trappes FRANCE,
Sydney AUSTRALIA, Madrid SPAIN
and the Kingdom of BAHRAIN.

Registered to ISO 9001:2000 Reg no. Q 09290
Registered to ISO 14001 Reg no. EMS 61597

CTER_91_DS_en_V10

www.megger.com
Megger is a registered trademark